


Operating Instruction

EXIOS
+ A2F

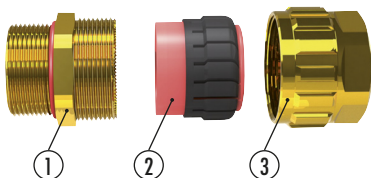

1. Entry Component
2. Sealing
3. Dome Nut

Operating temperature range -60 °C – +105 °C

Protection Type rating 4/4X/6 / IP 66, 67, 68 (5 bar – 30 min)

Certification Details: EXIOS A2F

II 2G Ex db eb IIC Gb / II 1D Ex ta IIIC Da

IECEX: DEK 12.0039X

ATEX: DEKRA 12ATEX0139 X

Class I, Div 2, ABCD; Class II, Div 1 & 2, EFG

Class I, Zone 1, AEx de IIC Gb; Zone 20, AEx ta IIIC, T125 °C Da

CSA: 12.2557737X

DIN EN IEC 60079-0: 2019

DIN EN 60079-1: 2015

DIN EN IEC 60079-7 / A1: 2018

DIN EN 60079-31: 2014

DIN EN 60529: 2014

EU Directive 2014/34/EU

HUMMEL AG

Lise-Meitner-Straße 2

79211 Denzlingen / Germany

Tel. +49 (0) 76 66 / 911 10-200

info@hummel.com

General information:

- The max. surface roughness of the device or housing cannot exceed Rz 16.
- The connection hole for the cable gland must be perpendicular to the sealing surface of the housing. In addition, the seal of the cable gland must completely cover the sealing surface on the housing.
- The installation of earthing tags is only permitted on the sealing surface between the housing and the cable gland. The user has to ensure the tightness with regard to IP and explosion protection.
- There are no restrictions regarding the housing material.
- Sealing method: The sealing at the cable is done by the sealing insert. Sealing at the housing is done by an O-ring.
- Our metric-size cable glands are provided as standard with an O-ring on the connecting thread.
- Before initial operation of the facilities, the assembly is to be checked to see that it conforms to these installation instructions, to the applicable national and international standards, as well as those applicable to the use in question.
- Suitable tools must be used for the assembly; furthermore, the installation may only be carried out by qualified electricians or by trained staff.
- Any modification which differs from the condition as delivered is not permitted.
- The cable glands are only permitted for permanently installed cables (25 %).
- In order to fulfill explosion protection type Ex d, the cable used must be round and compact, the cables must also take into consideration in particular the Regulations as per IEC 60079-14 Section 9.3. Observe the Regulations of IEC 60079-14 on direct insertion into the Ex d area.
- At the specified maintenance intervals it is recommended to check the compression fittings and tighten as necessary.
- In the case of NPT connecting threads, the end-user must ensure that the necessary IP protection is guaranteed; this can be done using a suitable thread sealing agent.
- When installing the cable gland through bore holes, care should be taken that the maximum diameters are not exceeded.
- The cable glands are provided with a sealing ring with an axial sealing height of at least 5 mm. With reference to the clearance groove, the end-user should ensure that at least five complete turns of the connector thread are made. In order to guarantee a screw depth of 8 mm, the enclosure should have a wall thickness of min. 10 mm; if < 10 mm, then if necessary, use a washer when cable entries are attached to the flameproof enclosure.
- When determining the temperature ranges of the device in the dust Ex-area, the Regulations of EN 60079-0 and EN 60079-31 must be taken into consideration.
- The screw connection is only approved for one-time use/assembly. There is no guarantee or liability for multiple/repeated use of the screw connection in a used condition.

Table 1 – NPT

Gland Size	AG	Ø mm	GL mm	Ø _k mm A ₁	Nm !
20-1	NPT 3/8"	22	16	6-12	8
20-1	NPT 1/2"	22/24	20	6-12	8
20-2	NPT 1/2"	24	20	9-16	8
20-3	NPT 3/4"	30	20,5	12,5-20,5	12
25	NPT 1"	36	25	16,9-26	18
32	NPT 1 1/4"	46	26	22-33	30
40	NPT 1 1/2"	55	26,5	28-41	50
50	NPT 2"	65	27	40-52,6	60
63	NPT 2 1/2"	80	40	51-61	65
75	NPT 3"	95	41,5	62-78	135


Table 2 – M

Gland Size	AG	Ø mm	GL mm	Ø _k mm A ₁	Nm !
20-1	M 16 x 1,5	22	16	6-12	8
20-1	M 20 x 1,5	22	16	6-12	8
20-2	M 20 x 1,5	24	16	9-16	8
20-3	M 25 x 1,5	30	16	12,5-20,5	12
25	M 32 x 1,5	36	16	16,9-26	18
32	M 40 x 1,5	46	16	22-33	30
40	M 50 x 1,5	55	16	28-41	50
50	M 63 x 1,5	65	16	40-52,6	60
63	M 75 x 1,5	80	16	51-65,3	65
75	M 90 x 2	95	20	62-78	135

! Recommended torque only refer to inspection specifications acc. to listed standards. Individual torques may differ due to type and character of the cable.

Installation conditions - through hole (only Ex-e)


The cable gland must be fixed with a lock nut



Thread	D1	D2	S
M6x1	6	7,3	2,5
M8x1,25	8	9	2,5
M10x1,5	10	10,4	2,5
M12x1,5	12	13	2,5
M16x1,5	16	17	2,5
M20x1,5	20	21	2,5
M25x1,5	25	26	2,5
M32x1,5	32	33	2,5
M40x1,5	40	41	2,5
M50x1,5	50	51	2,5
M63x1,5	63	64	2,5
M75x1,5	75	76	2,5
M80x2	80	81	4
M90x2	90	91	5
M100x2	100	101,3	5
M110x2	110	111	5

Installation conditions - thread

For all thread sizes the thread tolerance is 6g




Thread	D1	D2	S	Thread	D1	D2	S
Pg7	12,7	13,2	2,5	NPT 3/8"	17,3	18	4
Pg9	15,4	15,9	2,5	NPT 1/2"	21,1	22	5
Pg11	18,8	19,3	2,5	NPT 3/4"	26,7	27,5	4
Pg13,5	20,7	21,2	2,5	NPT 1"	34,3	35	4
Pg16	22,8	23,3	2,5	NPT 1 1/4"	41,9	42,5	5
Pg21	28,6	29,1	3	NPT 1 1/2"	48,8	49,5	5
Pg29	37,4	38,4	3	NPT 2"	61,1	62,0	5
Pg36	47,5	48,5	3	NPT 2 1/2"	74,0	76,5	6
Pg42	54,5	55,5	3	NPT 3"	89,8	92,5	6
Pg48	59,8	60,8	3				

D1: through hole

D2: countersink


If the cable gland is used in a way that deviates from the specified installation conditions, the user must ensure the safety of the system.

ASSEMBLY

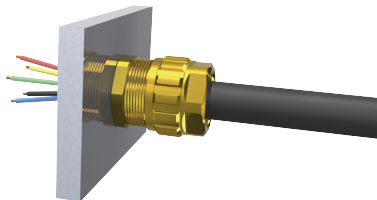

The Cable gland can be installed at the enclosure or etc, after that the cable can be assembled through the gland, the dome nut can now be tightened.

To speed up assembly, it can be tightened by hand to start with. Then tighten up using an open-ended spanner (Nm).

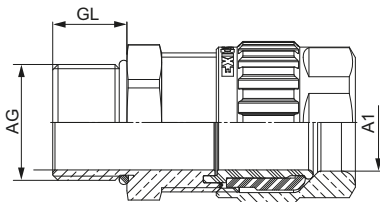

UK Declaration of Conformity

product name: **Cable Glands**
 type: **EXIOS A2F**



Complying the UK-legislation:

Equipment and Protective Systems Intended for use in Potentially Explosive Atmospheres Regulations 2016

Certified in EU-Type Examination certificate:

DEKRA 12 ATEX 0139 X

Issued by:

DEKRA Testing and Certification GmbH DEKRA Certification B.V.
 Dinnendahlstraße 9 Meander 1051
 D-44809 Bochum NL-6825 MJ Arnhem
 EU-Notified Body 0158 EU-Notified Body 0344

Marking of the Ex-Products:

 II 2G Ex db eb IIC Gb IP68/IP58
 II 1D Ex ta IIIC Da

Following standards re applied:

EN IEC 60079-0:2018	Explosive atmospheres – Part 0: Equipment – General requirements
EN 60079-1:2014	Explosive atmospheres – Part 7: Equipment protection by flameproof enclosures "d" Exception: labeling on the product with "d" equates to "db"
EN IEC 60079-7:2015 +A1:2018	Explosive atmospheres – Part 7: Equipment protection by increased safety "e" Exception: labeling on the product with "e" equates to "eb"
EN 60079-31:2014	Explosive atmospheres – Part 31: Equipment dust ignition protection by enclosure "T"
EN 60529:1991 + A1:2000 + A2:2013	Degrees of protection provided by enclosures (IP-Code)



Complying the UK-legislation:

The Restriction of the Use of Certain Hazardous Substances in Electrical and Electronic Equipment Regulations 2012

Following standards are applied:

EN IEC 63000:2018	Technical documentation for the assessment of electrical and electronic products with respect to the restriction of hazardous substances
--------------------------	--

We declare that the above articles were developed and manufactured in the responsibility of Hummel AG.

This UKDOC has been prepared in accordance with the transitional arrangement. This allows a self-declaration based on an ATEX certificate to mark the products in hazardous areas with UKCA.

Ort, Datum **Hummel AG**
 Dendingen den **08. NOV. 2022**

(Signature)
 I.V. Carsten Koch
 Vice President Engineering
 ATEX-Representative

(Signature)
 I.A. Christian Latte
 Team Leader Technical Compliance
 Zulassungsbeauftragter



EU-Konformitätserklärung / EU-Declaration of Conformity

Dokument:
 Version:
 Freigabe art:

Produktbezeichnung / product name: **Kabelverschraubung / Cable Glands**
 Typenbezeichnung / type: **EXIOS A2F**

Im Sinne der EU-Richtlinie 2014/34/EU, Anhang X
 Complying the EU-Directive 2014/34/EU, Attachment X

EU-Baumusterprübscheinung / Certified in EU-Type Examination certificate:

DEKRA 12 ATEX 0139 X

ausgestellt durch die benannte Stelle / issued by:

DEKRA Testing and Certification GmbH DEKRA Certification B.V.
 Dinnendahlstraße 9 Meander 1051
 D-44809 Bochum NL-6825 MJ Arnhem
 Notified Body 0158 Notified Body 0344

Kennzeichnung der Ex-Produkte / marking off the Ex-Products:

 II 2G Ex db eb IIC Gb IP68/IP58
 II 1D Ex ta IIIC Da

Folgende harmonisierte Normen sind angewandt / Following standards are applied:

DIN EN IEC 60079-0: 2019	Explosionsgefährdete Bereiche – Teil 0: Betriebsmittel – Allgemeine Anforderungen
DIN EN 60079-1: 2015	Explosionsgefährdete Bereiche – Teil 1: Geräteschutz durch druckfeste kapselung „d“
DIN EN IEC 60079-7 /A1:2018	Explosionsgefährdete Bereiche – Teil 7: Geräteschutz durch erhöhte Sicherheit „e“
DIN EN 60079-31: 2014	Explosionsgefährdete Bereiche – Teil 31: Geräte-Staubexplosionsschutz durch Gehäuse „I“
DIN EN 60529: 2014	Explosionsgefährdete Bereiche – Teil 31: Equipment dust ignition protection by enclosure „T“ Schutzarten durch Gehäuse (IP-Code)
	Degrees of protection provided by enclosures (IP-Code)

Im Sinne der EU-Richtlinie 2011/65/EU, Anhang IV
 Complying the EU-Directive 2011/65/EU, Attachment IV

Folgende Normen sind angewandt / Following standards are applied:

DIN EN IEC 63000 : 2019	Technische Dokumentation zur Beurteilung von Elektro- und Elektronikgeräten hinsichtlich der Beschränkung gefährlicher Stoffe
	Technical documentation for the assessment of electrical and electronic products with respect to the restriction of hazardous substances

Die oben genannten Produkte sind in alleiniger Verantwortung der HUMMEL AG entwickelt und gefertigt.
 We declare that the above articles were developed and manufactured in the responsibility of Hummel AG.

Ort, Datum **Hummel AG**
 Dendingen den **15.9.2024**

(Signature)
 Michael Nör
 Vorstandsvorsitzender / CEO

(Signature)
 Carsten Koch
 Ex-Beauftragter / ATEX-Representative

www.hummel.com